

COVID-19 Variants in Wastewater, Clark County Water Reclamation District

November 7, 2023

The information about variants identified in Clark County reflects wastewater samples of COVID-19 collected and tested from Clark County Water Reclamation District. This provides the Health District's Division of Disease Surveillance and Control with information about variants that are circulating in the community. On Oct 30, 2023, the most recent sample data available, the following variants were identified in samples from the Clark County Water Reclamation District:


Clark County Water Reclamation District – Wastewater Samples

Last Sample date: 10/30/2023

Variants	Percent
BQ.1	0%
XBB.1	5%
XBB.1.5	32%
XBB.1.9	0%
XBB.1.16	11%
XBB.2.3	0%
FU.1	0%
EG.5	0%
EG.6	3%
EU.1.1	0%
FD.2	0%
FY.3	0%
FL.1.5.1	0%
HV.1	48%
BA.2.86	0%
HK.3	0%
Others	0%

Source: UNLV, School of Medicine,
<https://empower.unlv.edu/>

Clark County Water Reclamation District

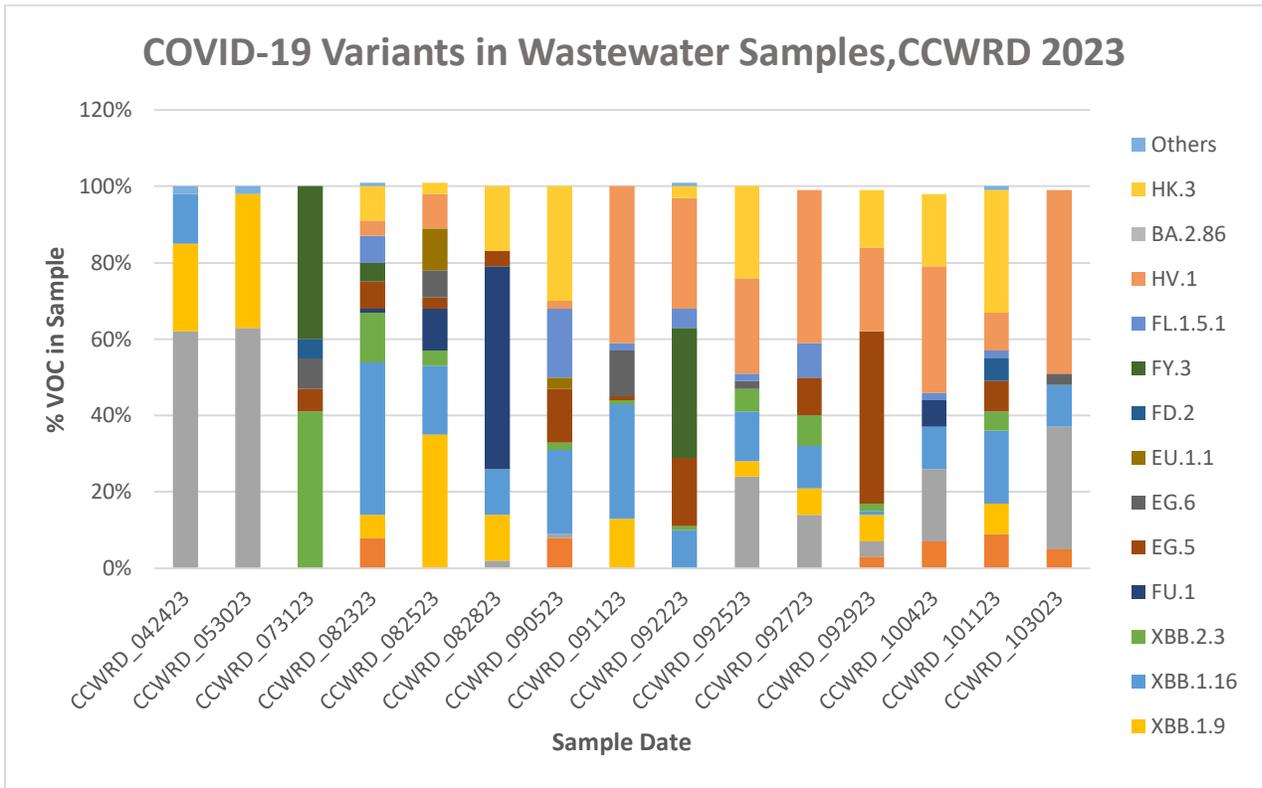


Source: UNLV School of Medicine, <https://empower.unlv.edu/>

Amount of COVID-19 Virus in Wastewater Samples By Collection Date, 2023

Clark County Water Reclamation District (CCWRD) Flamingo Water Resource Center (FWRC)

Medium: No trend and medium concentration last 21 days

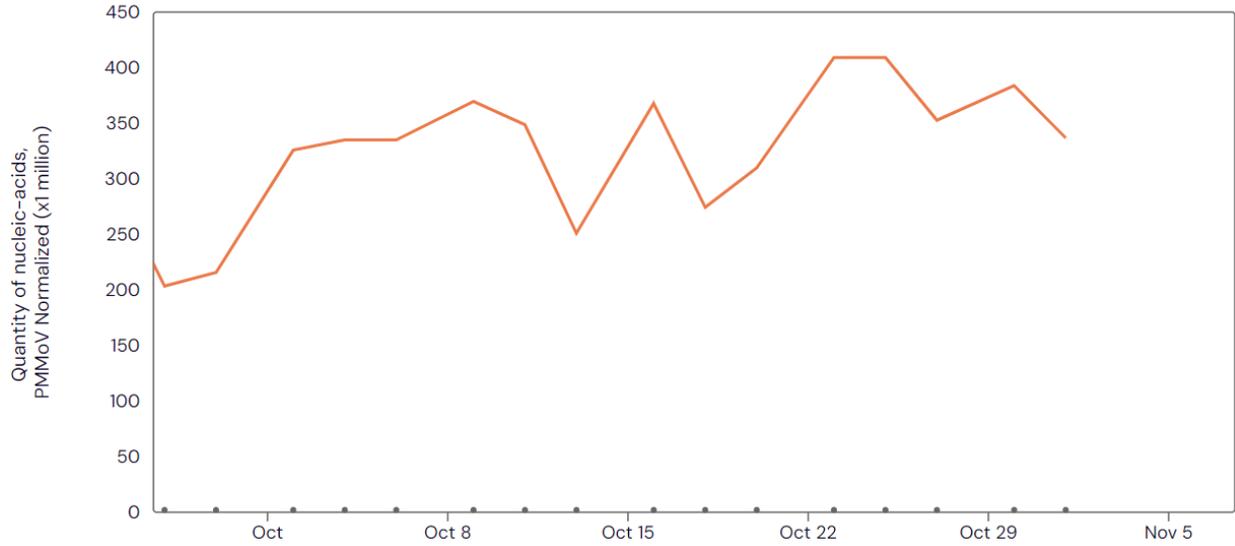

Source: <https://data.wastewaterscan.org/>